

SLIP RESISTANCE TEST REPORT



Project : Slip Resistance Investigation
 Location of Test : Auckland Laboratory
 Client : Ecofloors Ltd
 Slider type : FOUR-S/Slider 96, Prepared on P 400 (or equivalent) sand paper & Lapping Film
 Specimen Description : ECOSAFE HD Aquatread Resilient Safety Floor

Cleaning Procedure : Wet Brush
 Test Type : Unfixed
 Air Temp at Test (°C) : 14

Project Number : 1-LA346.00
 Lab Ref. Number : AL6441/1
 Client Ref. Number : -


SLIP RESISTANCE TEST RESULTS

SLIP RESISTANCE TEST RESULTS			
Specimen N° :	Test Direction :	Mean BPN :	Mean Coefficient of Friction* :
1	N/A	60	0.67
2		59	0.65
3		59	0.65
4		62	0.69
5		60	0.67
Average SRV :		60	0.67
Classification of pedestrian surface material in accordance with table 2, AS 4586:2013 :			P5

TEST METHOD

Tests were carried out in accordance with Appendix A, AS 4586:2013, the classification is based on a test in the wet condition.
 *Coefficient of friction obtained from: AS/NZS 3661.1 : 1993 Slip Resistance of Pedestrian Surfaces.

SAMPLE TESTED

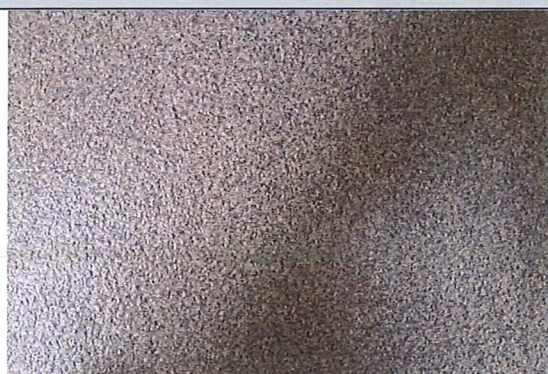

Tested By : G. Sandford
 Designation : Civil Engineering Technician
 Date Tested : 5/07/21

LAF026 (08/17)